



POTABLE SYSTEM TO BUILDING WITH PRIVATELY MAINTAINED HYDRANTS

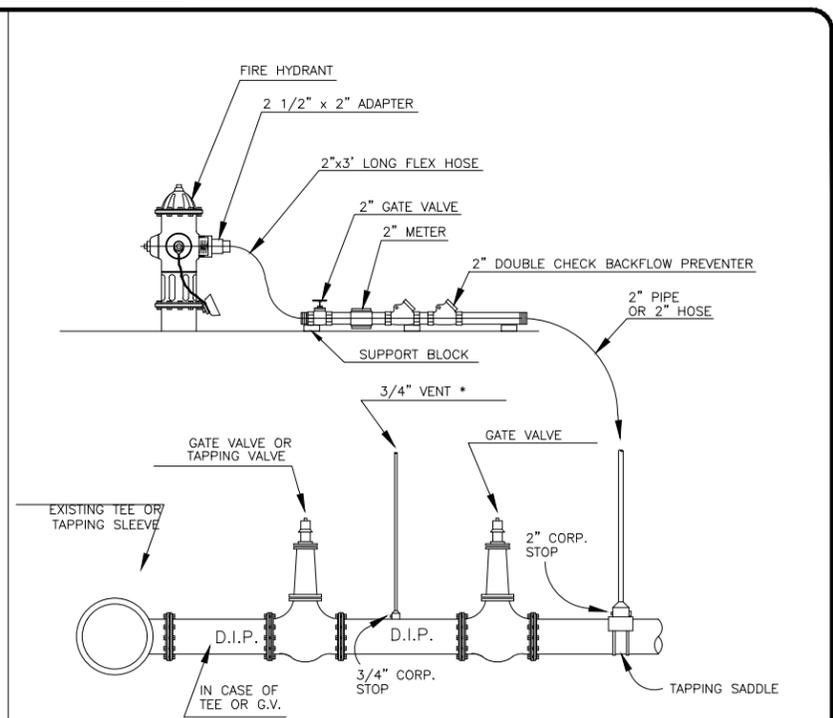

FILLING CONNECTION

* NOTE: AFTER TESTS REMOVE 3/4" TUBING AND 2" GALVANIZED PIPE AND INSTALL PLUGS ON CORPORATION STOPS.

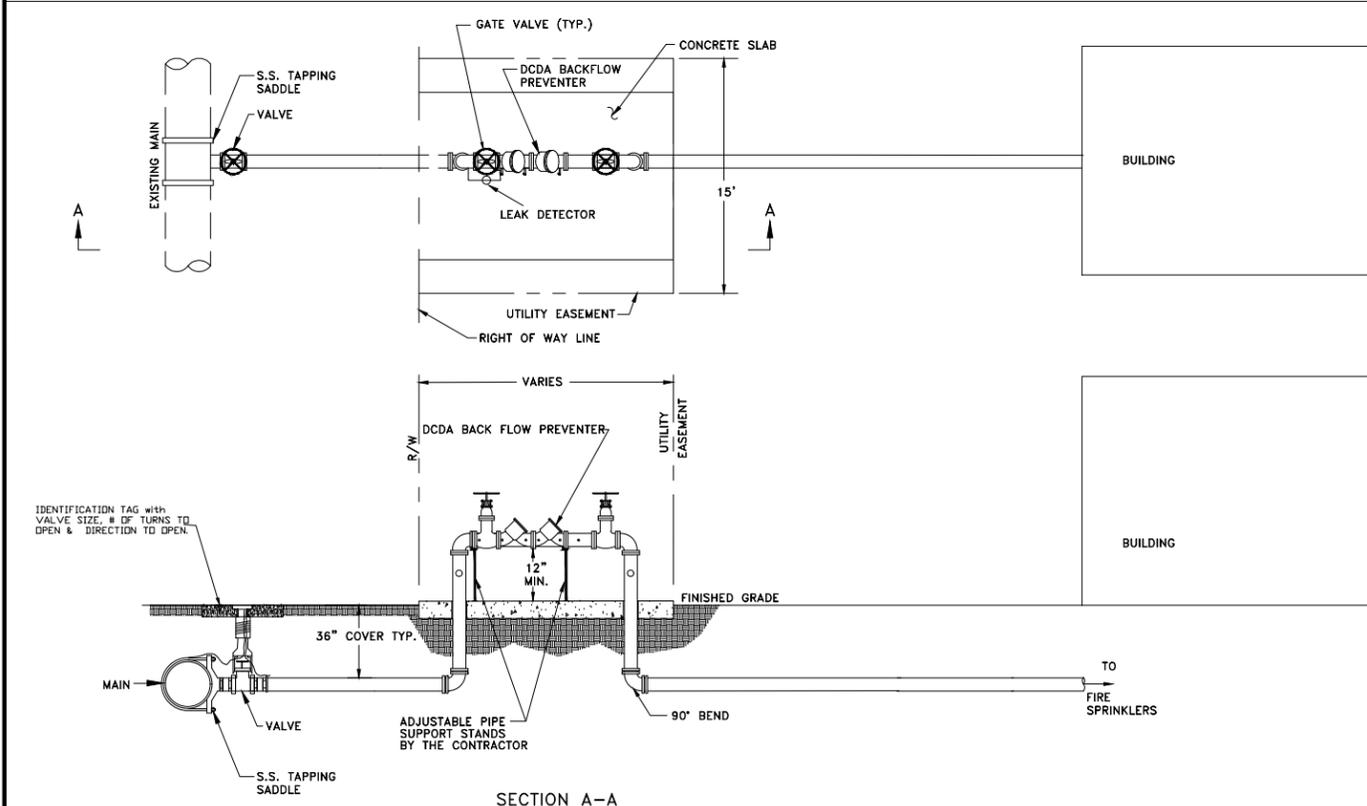

FIRE LINE SYSTEM TO BUILDING

NOTE:

NFPA 24 AND 25 SHOULD BE APPLIED ON FIRE SYSTEM.

PAINT FIRE LINE SYSTEM RED BUT DO NOT PAINT BRASS.

PAINT POTABLE METER ASSEMBLY BLUE WHEN COMPLETED BUT DO NOT PAINT BRASS.

ISSUE CODE
 MODIFIED MJC 12-07-21
 MODIFIED MJC 07-16-21
 MODIFIED ROS 05-18-23

CITY OF LAKE WALES
 LAKE WALES, FLORIDA 33853



ISSUE CODE	A PRELIMINARY	B DESIGN
	C BIDS	D CONSTRUCTION
	E APPROVAL	
DESIGN:	SCALE: N.T.S.	
CHK'D BY:	DATE:	
DRAWN BY:	ENGR. APPR.	
DRAWING TITLE		
FIRE LINE SYSTEM, FIRE HYDRANT & FILLING CONNECTION DETAILS		
JOB NO.		
AREA	REV.	
CITY-OF-LAKE-WALES		